




LANDSCAPE IRRIGATION SYSTEM

PRESSURE VACUUM BREAKER BACK-SIPHON ASSEMBLY;
 VALVES ARE ALLOWED DOWNSTREAM OF A P.V.B. MINIMUM ELEVATION
 REQUIREMENT OF TWELVE INCHES (12") ABOVE HIGHEST POINT IN SYSTEM MUST
 BE MET. ASSEMBLY IS DESIGNED TO PROTECT AGAINST A BACK-SIPHON
 CONDITION ONLY.

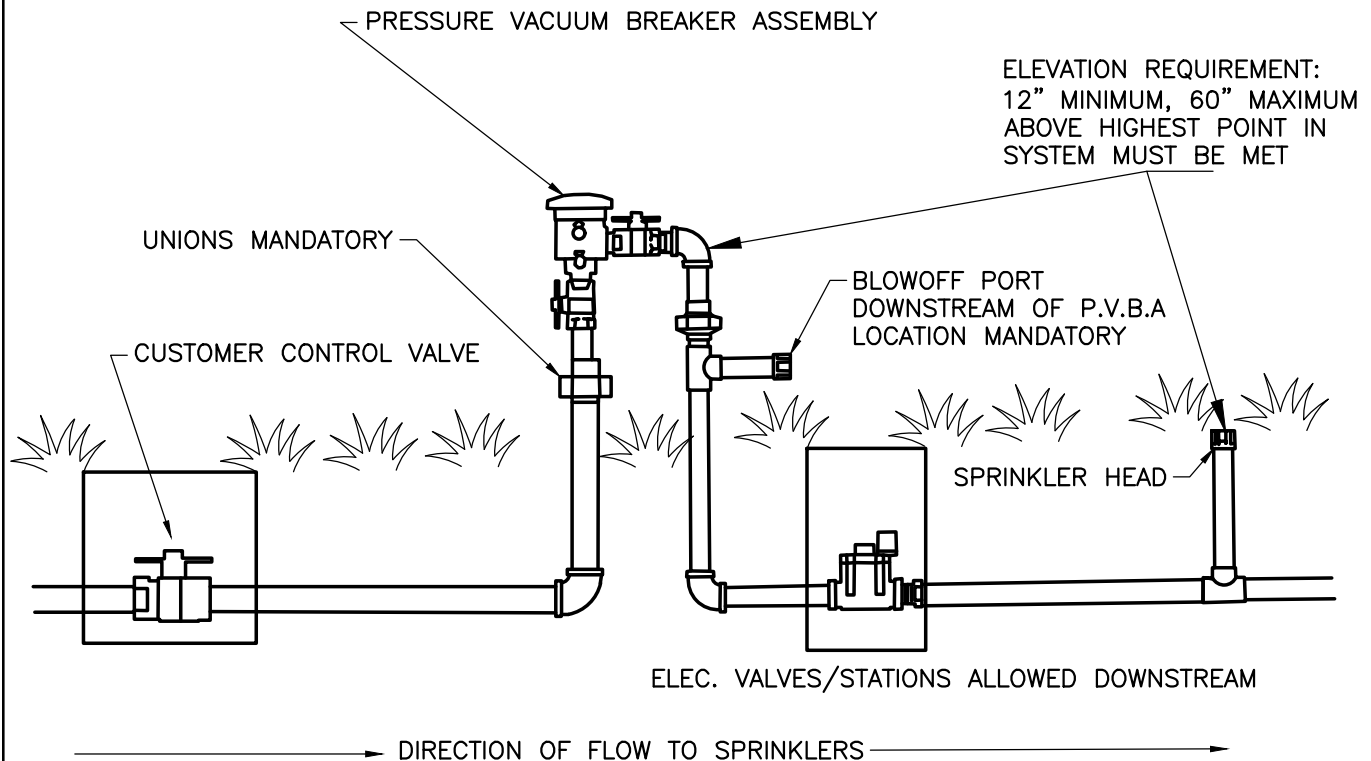

NOT TO SCALE

	East Greenacres Irrigation District	Approved by:
	Pressure Vacuum Breaker Assembly	 District Manager
		Standard Drawing No. W-11