


# LANDSCAPE IRRIGATION SYSTEM

ATMOSPHERIC VACUUM BREAKER BACK-SIPHON PREVENTION ASSEMBLY (AVB) IS "UNTESTABLE" APPROVED BACKFLOW PREVENTION ASSEMBLY.

NOTE: ASSEMBLY SHALL NOT BE SUBJECTED TO OPERATING PRESSURE FOR MORE THAN TWELVE (12) HOURS IN ANY TWENTY FOUR (24) HOUR PERIOD.

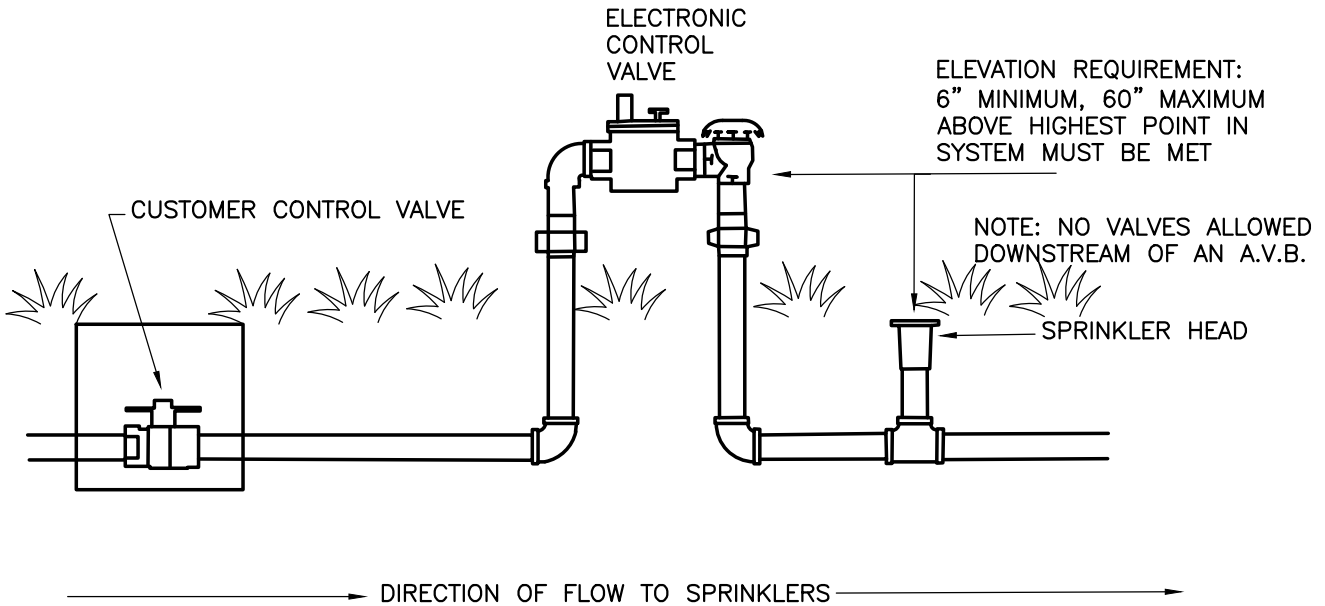

NOT TO SCALE



East Greenacres Irrigation District

**ATMOSPHERIC VACUUM  
BREAKER ASSEMBLY**

Approved by:

*R. White*  
District Manager

5/15/18  
Date

Standard Drawing No.

**W-12**